

Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

Client Ref.

Report No.

200862PC200068(2)A

Page 1 of 5

# REPORT ON TESTING OF COPPER ALLOY (BRASS) SWING CHECK VALVE WITH SCREWED ENDS

# **Information Supplied by Client**

Client : Wah Hung Fire Prevention Equipment Co., Limited

Client Address : G/F, No.129, Tai Nan Street, Prince Edward, Kowloon, Hong Kong

Sample Description : 40mm(1-1/2") Copper Alloy (Brass) Swing Check Valve With Screwed Ends

Model : WH027

Brand : WAH HUNG

Body Marking : 11/2

Country of Origin ; China

Manufacturer Wah Nan Fire Fighting Equipment Co., Ltd.

A STATE OF THE STA

Lab. Sample I.D.PC200068/3Date Received07 Apirl 2020Date Test Started20 April 2020

Lab. Sample I.D.	Nominal Size	BS Regirement	L (mm)	H (mm)	Manufa Reqire (m	ement	Result
	(DN)	,	(*****)	(4444)	L	Н	
PC200068/3	40 mm (1-1/2")	40 mm (1-1/2")	92	63	92	63	PASS

The Female thread comply with BS21: 1985

## 2. Shell and Seat Tightness to Internal Pressure

BS 5154: 1991, Clause 11

	Shell Test					
Lab Sample I.D.	Nominal Pressure PN (bar)	Test Pressure (bar)	Duration (sec)	Observation	Result	
PC200068/3	16	24	15	No leakage	Pass	
BS 5154 : 1991 Clause 11 Table 11 Requirement	16	16 X 1.5 = 24	15	No leakage during the test period		



Page 2 of

Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

5

Client Ref. Report No.

200862PC200068(2)A

BS 5154: 1991, Clause 11

	Seat Test				
Lab Sample I.D.	Nominal Pressure PN (bar)	Test Pressure (bar)	Duration (sec.)	Observation	Result
PC200068/3	16	17.6	15	No leakage	Pass
BS 5154 : 1991 Clause 11 Table 11 Requirement	16	16 X 1.1 = 17.6	15	No leakage during the test period	

## 3. Chemical Composition (Body)

BS 5154: 1991 clause 10

Testing items	Results	Specification according to BS EN 1982 : 2008 Grade CC754S castings
1 Aluminium (Al) content, %	0.21	0.8 max.
2. Copper (Cu) content, % 1)	62.0	58.0 - 63.0
3. Nickel (Ni) content, %	0.38	1.0 max,
4. Lead (Pb) content, %	2.4	0.5 – 2.5
5. Tin (Sn) content, %	0.63	1.0 max.
6. Zinc (Zn) content, %	34.2	Remainder
7. Iron (Fe) content, %	0.43	0.7 max.
8. Manganese (Mn) content, %	0.03	0.5 max.
9. Phosphorus (P) content, %	<0.02	0.02 max.
10. Silicon (Si) content, %	0.05	0.05 max.

Remark: 1) Including nickel

Note: Based on the test results of the submitted sample, it is found that the sample complies



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

Page 3 of 5

Client Ref.

. \_\_

Report No.

200862PC200068(2)A

# 4. Chemical Composition (Disc)

BS 5154: 1991 clause 10

Testing items	Results	Specification according to BS EN 1982 : 2008 Grade CC754S castings
1. Aluminium (Al) content, %	0.43	0.8 max.
2. Copper (Cu) content, % 1)	60.7	58.0 - 63.0
3. Nickel (Ni) content, %	0.39	1.0 max.
4. Lead (Pb) content, %	2.5	0.5 – 2.5
5. Tin (Sn) content, %	0.6	1.0 max.
6. Zinc (Zn) content, %	35.2	Remainder
7. Iron (Fe) content, %	0.48	0.7 max.
8. Manganese (Mn) content, %	0.03	0.5 max.
9. Phosphorus (P) content, %	<0.02	0.02 max.
10. Silicon (Si) content, %	0.04	0.05 max.

Remark: 1) Including nickel

Note: Based on the test results of the submitted sample, it is found that the sample complies with the chemical composition specification of BS EN 1982 : 2008 Grade CC754S castings. The chemical composition results are obtained from our test report no. 200862EN201096.

# 5. Chemical Composition (Hinge Pin)

BS 5154: 1991 clause 10

Testing items	Results	Specification according to BS EN 10088-1:2014 Grade X5CrNi18-10 (1.4301)
1. Carbon (C) content, %	0.04	0.07 max
2. Silicon (Si) content, %	0.43	1.00 max.
3. Manganese (Mn) content, %	1.12	2.00 max.
4. Phosphorus (P) content, %	0.019	0.045 max.
5. Sulfur (S) content, %	<0.011	0.015 max.
6. Chromium (Cr) content, %	17.7	17.5 – 19.5
7. Nickel (Ni) content, %	8.2	8.0 – 10.5

Note: Based on the test results of the submitted sample, it is found that the sample complies with the chemical composition specification of BS EN 10088-1:2014 Grade X5CrNi18-10 (1.4301). The chemical composition results are obtained from our test report no. 200862EN201096(1).



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

Client Ref. Report No.

200862PC200068(2)A

Page 4 of - 5

## 6. Chemical Composition (Bonnet)

BS 5154: 1991 clause 10

Results	Specification according to BS EN 1982 : 2008 Grade CC754S castings
0.11	0.8 max.
59.2	58.0 - 63.0
0.34	1.0 max.
2.3	0.5 – 2.5
0.83	1.0 max.
37.0	Remainder
0.41	0.7 max.
0.03	0.5 max.
<0.02	0.02 max.
0.05	0.05 max.
	0.11 59.2 0.34 2.3 0.83 37.0 0.41 0.03 <0.02

Remark: 1) Including nickel

Note: Based on the test results of the submitted sample, it is found that the sample complies with the chemical composition specification of BS EN 1982 : 2008 Grade CC754S castings. The chemical composition results are obtained from our test report no.200862EN201676

# 7. Summary of Results (apply only to sample tested)

**Dimensions**  Pass Shell and Seat Tightness to Internal Pressure -- Pass Chemical Composition (Body) -- Pass Chemical Composition (Disc) Pass Chemical Composition (Hinge Pin) -- Pass Chemical Composition (Bonnet) -- Pass

Remarks:

- The test results relate only to the samples tested. 1.)
- 2.) No coating was visible on the visual internal water contact surface of the sample.
- 3.) The test sample is shown in the photograph on page 5 of this report.
- 4.) This report is to supersede our previous test report no.200862PC200068(2).

Date:

28 JUL 2020 Certified by :

Date: 28 |||| 2020

Ng Shu Shing Chris

Assistant Manager (Plumping Components)




Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

Page 5 of 5

Client Ref. : --

Report No. : 200862PC200068(2)A

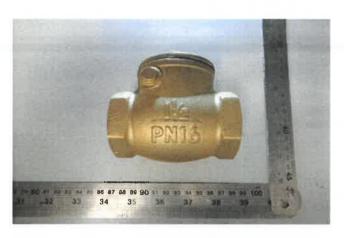

**Test Sample** 

