




Client Ref. : --
Report No. : 195909PC190345(3)

Page 1 of 4

REPORT ON TESTING OF DUCTILE IRON CONNECTOR

Information Supplied by Client

Client : Wah Hung Fire Prevention Equipment Co., Limited
Client Address : G/F, No.75, Bedford Road, Tai Kok Tsui, Kowloon, Hong Kong
Sample Description : Ductile iron tank connector (puddle flange) with three nos. of flanges, pressure rating PN16
Item No. : WH026B
Brand : WAH HUNG
Body Markings :  DI DN80X600 PN16 BSEN1092-2
Country of Origin : China
Model : DI-8024
Manufacturer : Wah Nan Fire Fighting Equipment Co., Ltd

Laboratory Information

Lab. Sample I.D. : PC190345/4
Date Received : 11 November 2019
Date Test Started : 15 November 2019
Date Test Completed : 06 December 2019
Test Method : BS EN 12266-1 : 2012, BS EN 1563 : 2011,
BS EN 545 : 2010 and BS EN 1092-2:1997

Test Results

1. Dimensions

| Lab Sample I.D. | Nominal Size (DN) | Dimension (mm) | | | | | | Results |
|-------------------|-------------------|------------------------------------|-----|-----|---------|------------|----------------|---------|
| | | Flange (BSEN 1092-2: 1997 table 9) | | | | | | |
| | | Length | D | K | L | C | Number of Hole | |
| PC190345/4 | 80 | 610 | 200 | 161 | 20 | 22.53 | 8 | Pass |
| BS EN Requirement | | N/A | 200 | 160 | 19 +1.5 | 19 +4 / -3 | 8 | |

Client Ref. : --

| | | | | | |
|--|----|-----------|----|-----------------------------------|--|
| <div style="background-color: black; height: 100px; width: 100%;"></div> | | | | | |
| BS EN 12266-1 : 2012 Clause A.4.3 Requirement | 16 | 16x1.5=24 | 10 | No leakage during the test period | |

3. Coating Thickness

BS EN 545 : 2010 Clasue 4.6

| Lab Sample I.D. | Average Coating Thickness (µm) | BS EN 545 : 2010 Requirement (µm) | Results |
|-----------------|--------------------------------|-----------------------------------|---------|
| PC190345/4 | 136 | min. 70 | Pass |

4. Tensile Test

BS EN 1563 : 2011

| Min. Diameter of Specimen (mm) | Effective Cross Sectional Area (mm²) | Tensile Load (kN) | Tensile Stress (N/mm²) | Gauge Length (mm) | Final Gauge Length (mm) | Elongation (%) | Failure Mode | BS EN Requirement |
|--------------------------------|--------------------------------------|-------------------|------------------------|-------------------|-------------------------|----------------|----------------|---|
| 20.16 | 319.206 | 165.6 | 519 | 30 | 33.48 | 12 | Break at Shank | Tensile Strength min. m450N/mm² Elongation min.10% |
| 19.98 | 313.531 | 166.5 | 531 | 30 | 33.21 | 11 | Break at Shank | |
| 19.86 | 309.776 | 163.9 | 529 | 30 | 33.51 | 12 | Break at Shank | |



Remarks : Sample test satisfy the tensile strength requirement of BS EN 1502 : 2004 material.

Client Ref. : --
Report No. : 195909PC190345(3)


5. Summary of Results (apply only to sample tested)

| | |
|-------------------|--|
| Dimensions | -- Pass |
| Leak Tightness | -- Pass |
| Coating Thickness | -- Pass |
| Tensile Test | -- Pass (EN-GJS-450-10 of BS EN 1563 : 2011) |

Remark : 1.) An epoxy coating was visible on the visual internal water contact surface of the sample.
2.) The test sample is shown in the photograph on page 4 of this report.

Checked by :  Date : 11 FEB 2020 Certified by :  Date : 11 FEB 2020
Ng Shu Shing Chris
Assistant Manager (Plumping Components)

Client Ref. : --
Report No. : 195909PC190345(3)

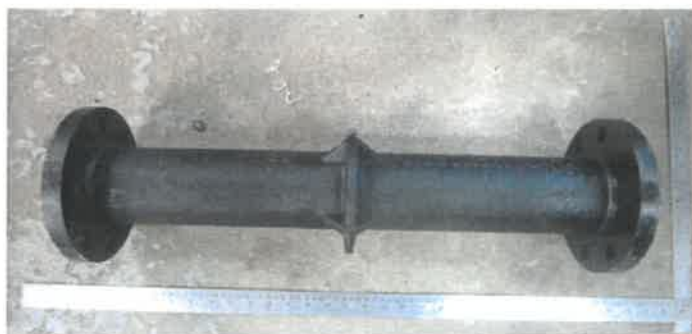

Test Sample
Sample I.D.: PC190345/4



Body Marking
Sample I.D.: PC190345/4



Body Marking
Sample I.D.: PC190345/4

****End of Report****